


CRACKS >1/4-INCH NEED TO BE ROUTED OUT.
 A BACKER ROD SHALL BE PLACED AT THE APPROPRIATE DEPTH, NO MORE THAN 1/2-INCH DEEP TO ENSURE THAT THE 2-PART URETHANE SYSTEM IS INSTALLED AT A 2:1 MINIMUM WIDTH TO DEPTH RATIO.
 APPLY THE 2-PART URETHANE JOINT SEALANT (BY OTHER) TO FILL THE CRACK AND ALLOW IT TO CURE A MINIMUM OF 12-HOURS AT 70 DEGREES F.
 APPLY CIM 2000 TOPCOAT OVER THE JOINT AND ONTO THE CONCRETE.

SHRINKAGE CRACKS BETWEEN 1/16-INCH AND 1/8-INCH SHALL BE STRIPE COATED



ROUGH SURFACE MAY REQUIRE FILLER MATERIAL (CIM/CEMENT/EPOXY GROUT) IF PROFILE > 1/4-INCH

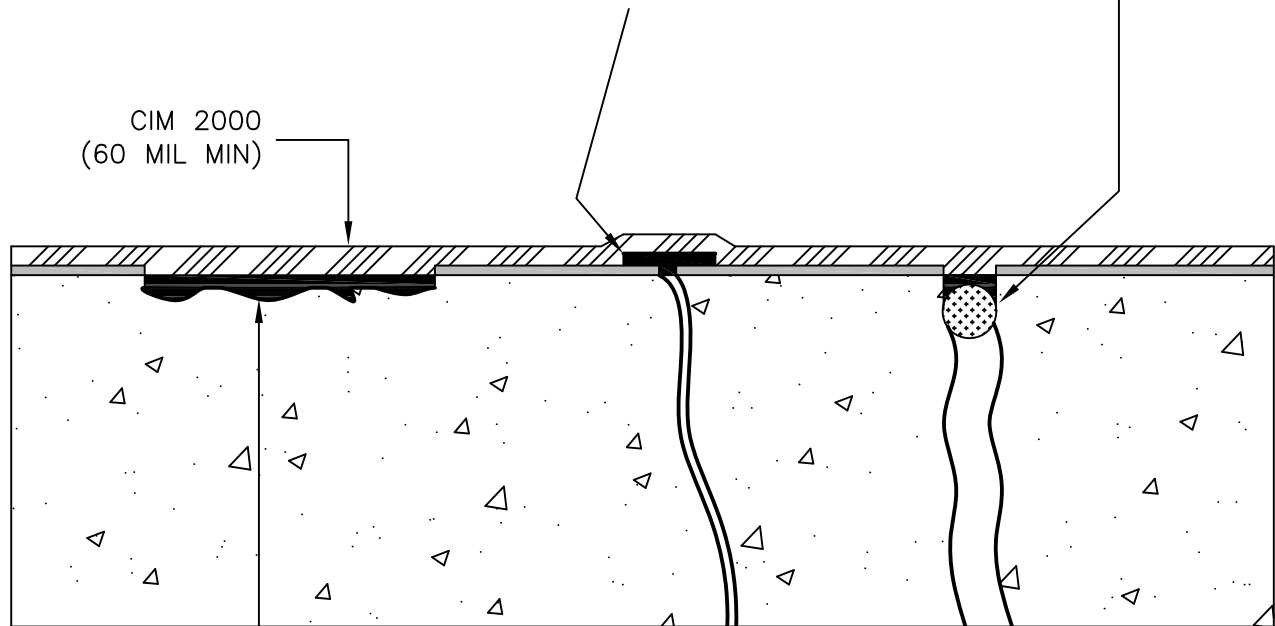

C.I.M. Industries Inc.
 23 Elm Street
 Peterborough, NH 03458
 www.cimindustries.com
 603-924-9481

DATE	CIM 03-0018
09.09.02	PROJECT: C.I.M. INDUSTRIES INC.
SCALE NTS	TITLE: CIM 2000 CRACK TREATMENT (STATIC)